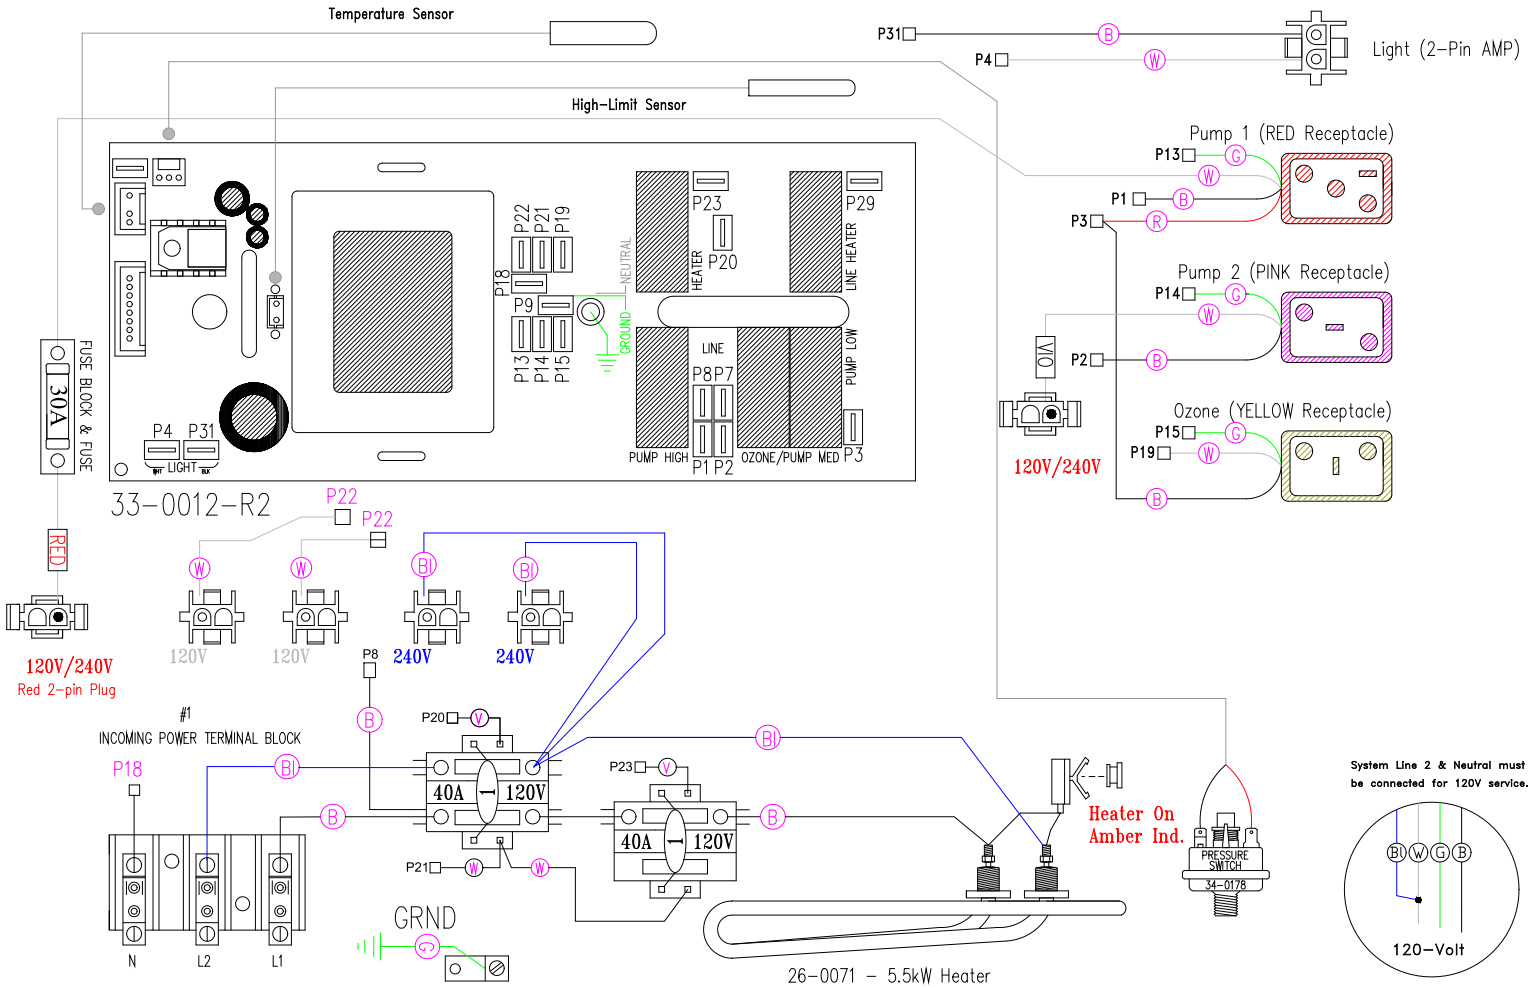

REV.	CHANGE	DATE
1	drawing created	11.15.06

** Rev's 1 - 3 missing, LSL revised w/o updating.

Manufacture Notes:

#1 - For 240V operation, Line 2 & Neutral wires must be separated.

#2 - For 240V operation of Pump or Ozone, remove 2-pin plug from 120V connector and reconnect to 240V connection.

Drawn	LSL
Rev	1
Date	11.15.06
Diagram No.	0635

Wire Color Code

B - Black	G - Green
Br - Brown	Bl - Blue
R - Red	V - Violet
O - Orange	W - White
Y - Yellow	Gr - Grey