


15 AMP CORD-END GFCI

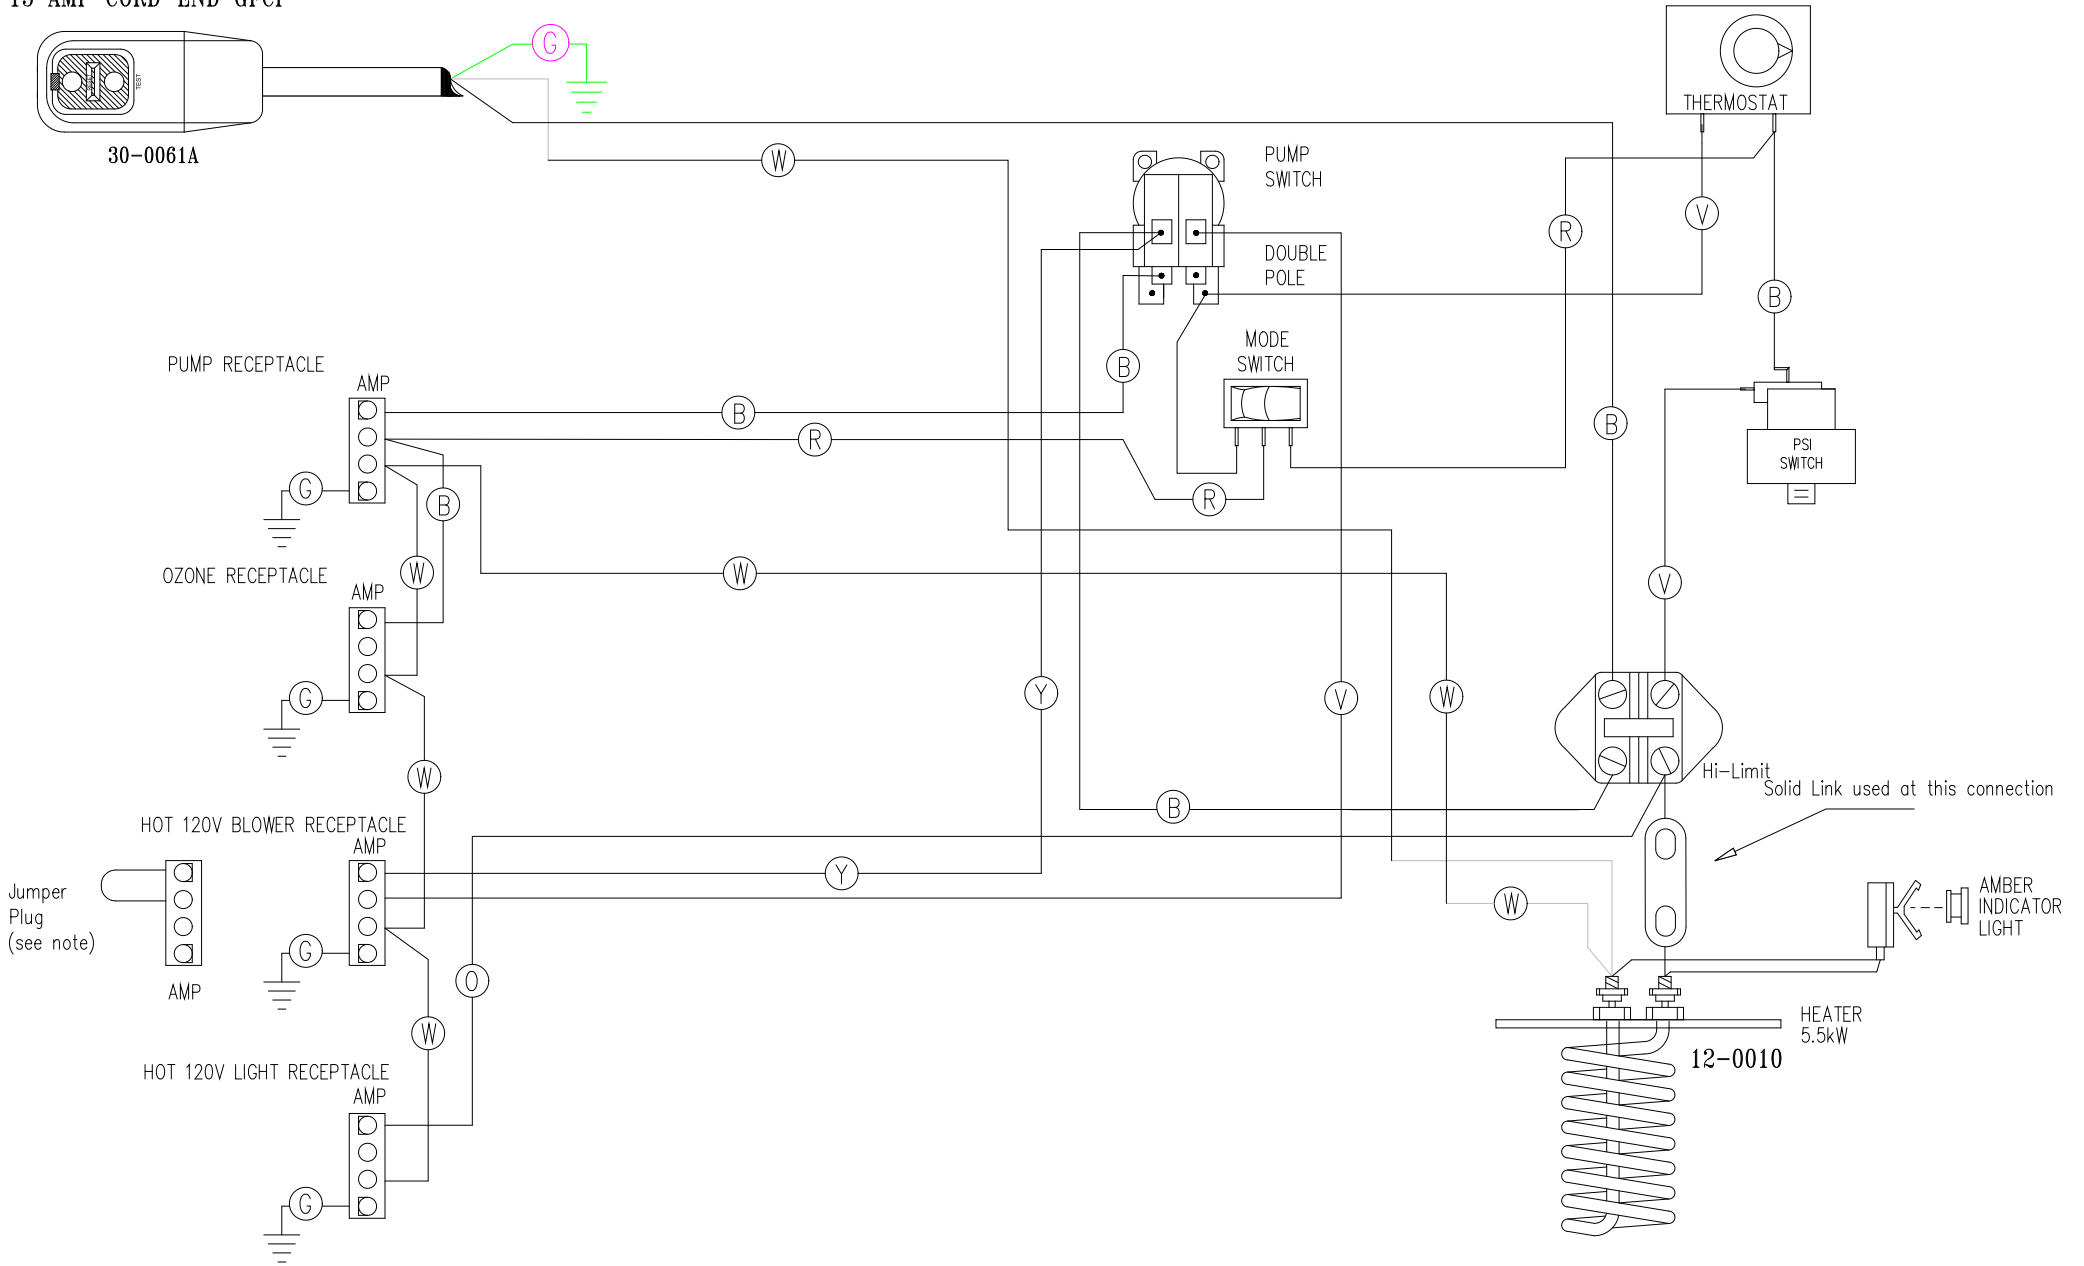

HYDRO-QUIP
CORONA, CA (909) 273-7575

Manufacture Notes: (C) ON RELAY INDICATES CAPACITOR.

Approved By:

Dwg. No.
101TG-BDEKQY7

Drawn
BH

Rev
3

Wire Color Code

NOTE: Jumper Plug is used when Blower is NOT installed. Failure to do so will cause the equipment to malfunction.

NOTE: ONLY Install 120V switched Air Blower when jumper is not installed.

Date
07.08.03

Diagram No.
939

B - Black	G - Green
Br - Brown	Bl - Blue
R - Red	V - Violet
O - Orange	W - White
Y - Yellow	