




USE COPPER CONDUCTORS ONLY



GFCI LOOP

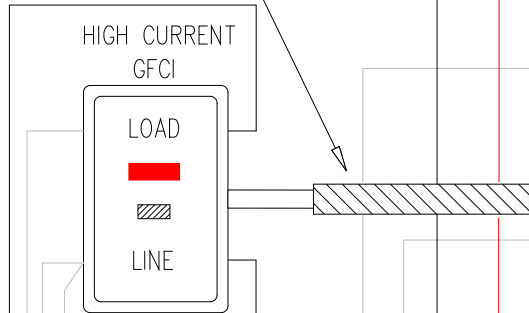


HIGH-CURRENT GFCI
 PT#: 48-0152A

VDS CONFIGURATION

- HEATER "ON"
- PUMP "ON"
- CHECK SYSTEM FUSE
- HIGH-LIMIT TRIPPED
- SYSTEM MIS-WIRE

Manufacture Notes:

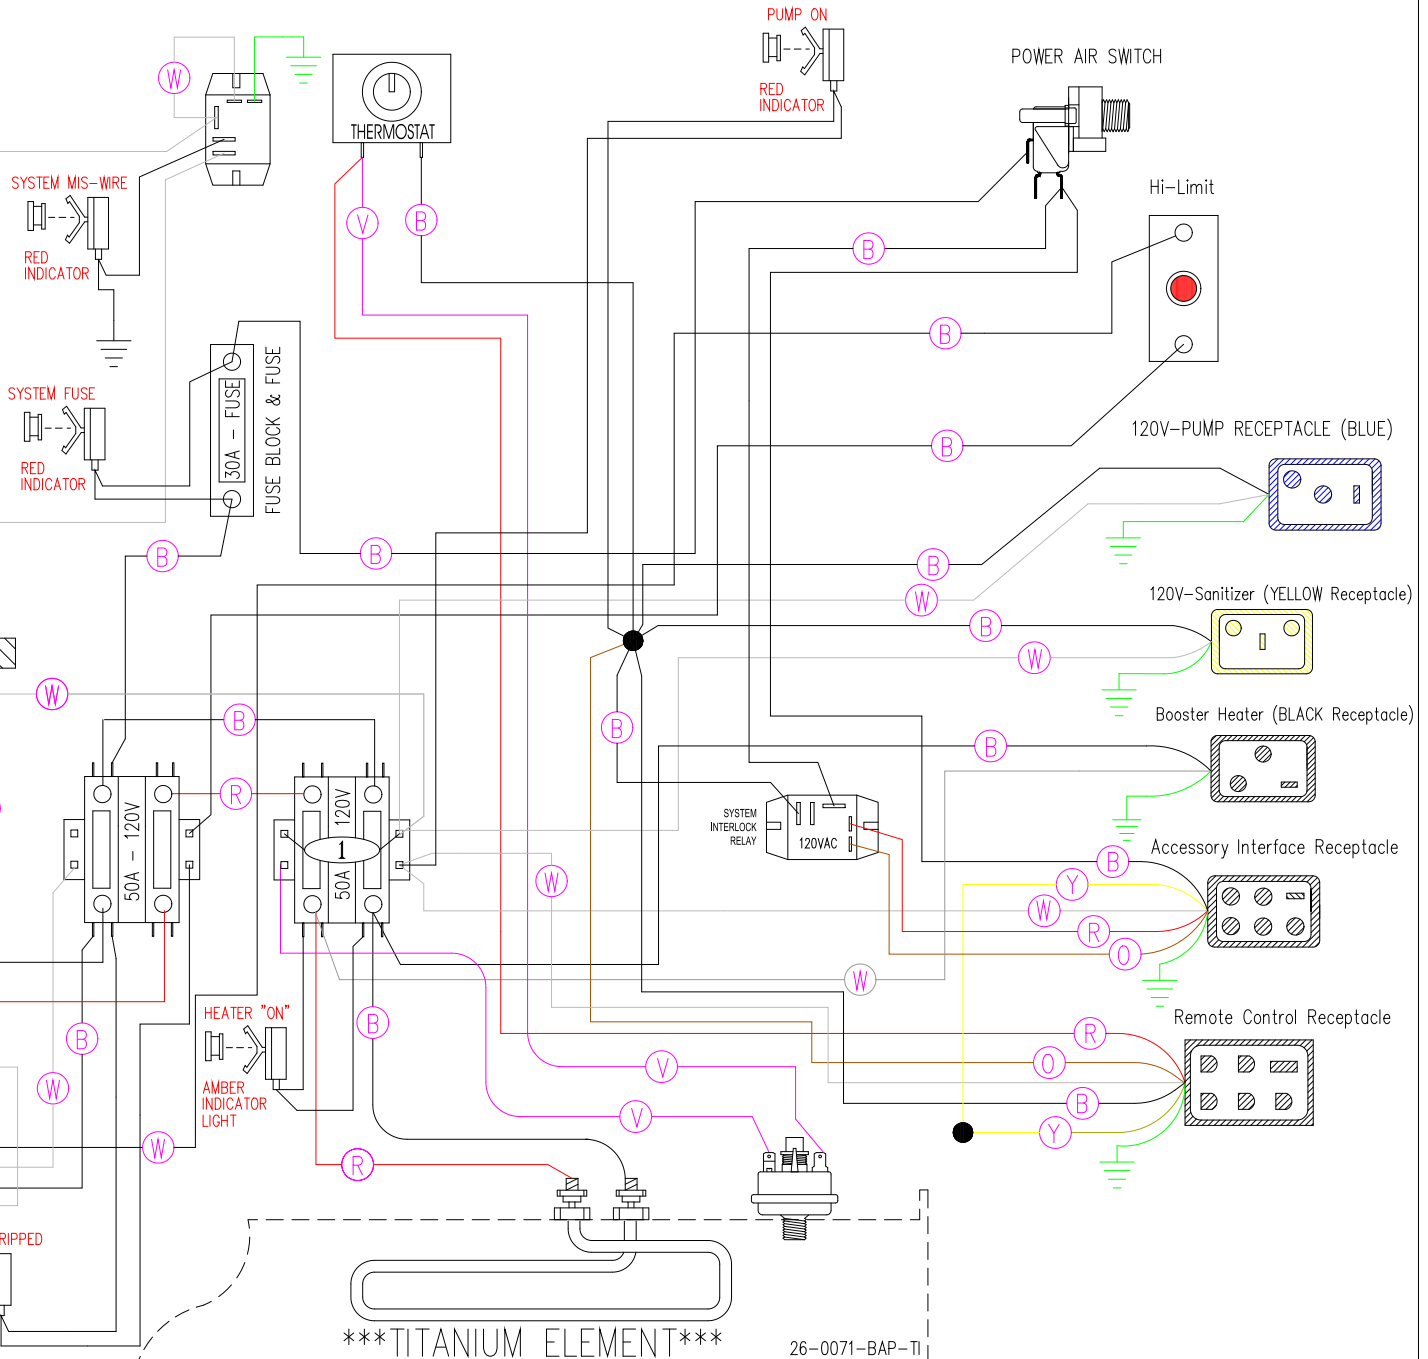

Dwg. No. 10000-HKQTY-J

Drawn MBS
 Date 12.20.10
 Diagram No. 2018

Rev 03
 Wire Color Code
 B - Black G - Green
 Br - Brown Bl - Blue
 R - Red V - Violet
 O - Orange W - White
 Y - Yellow Gr - Gray

26-0071-BAP-TI