


USE COPPER CONDUCTORS ONLY

DO NOT

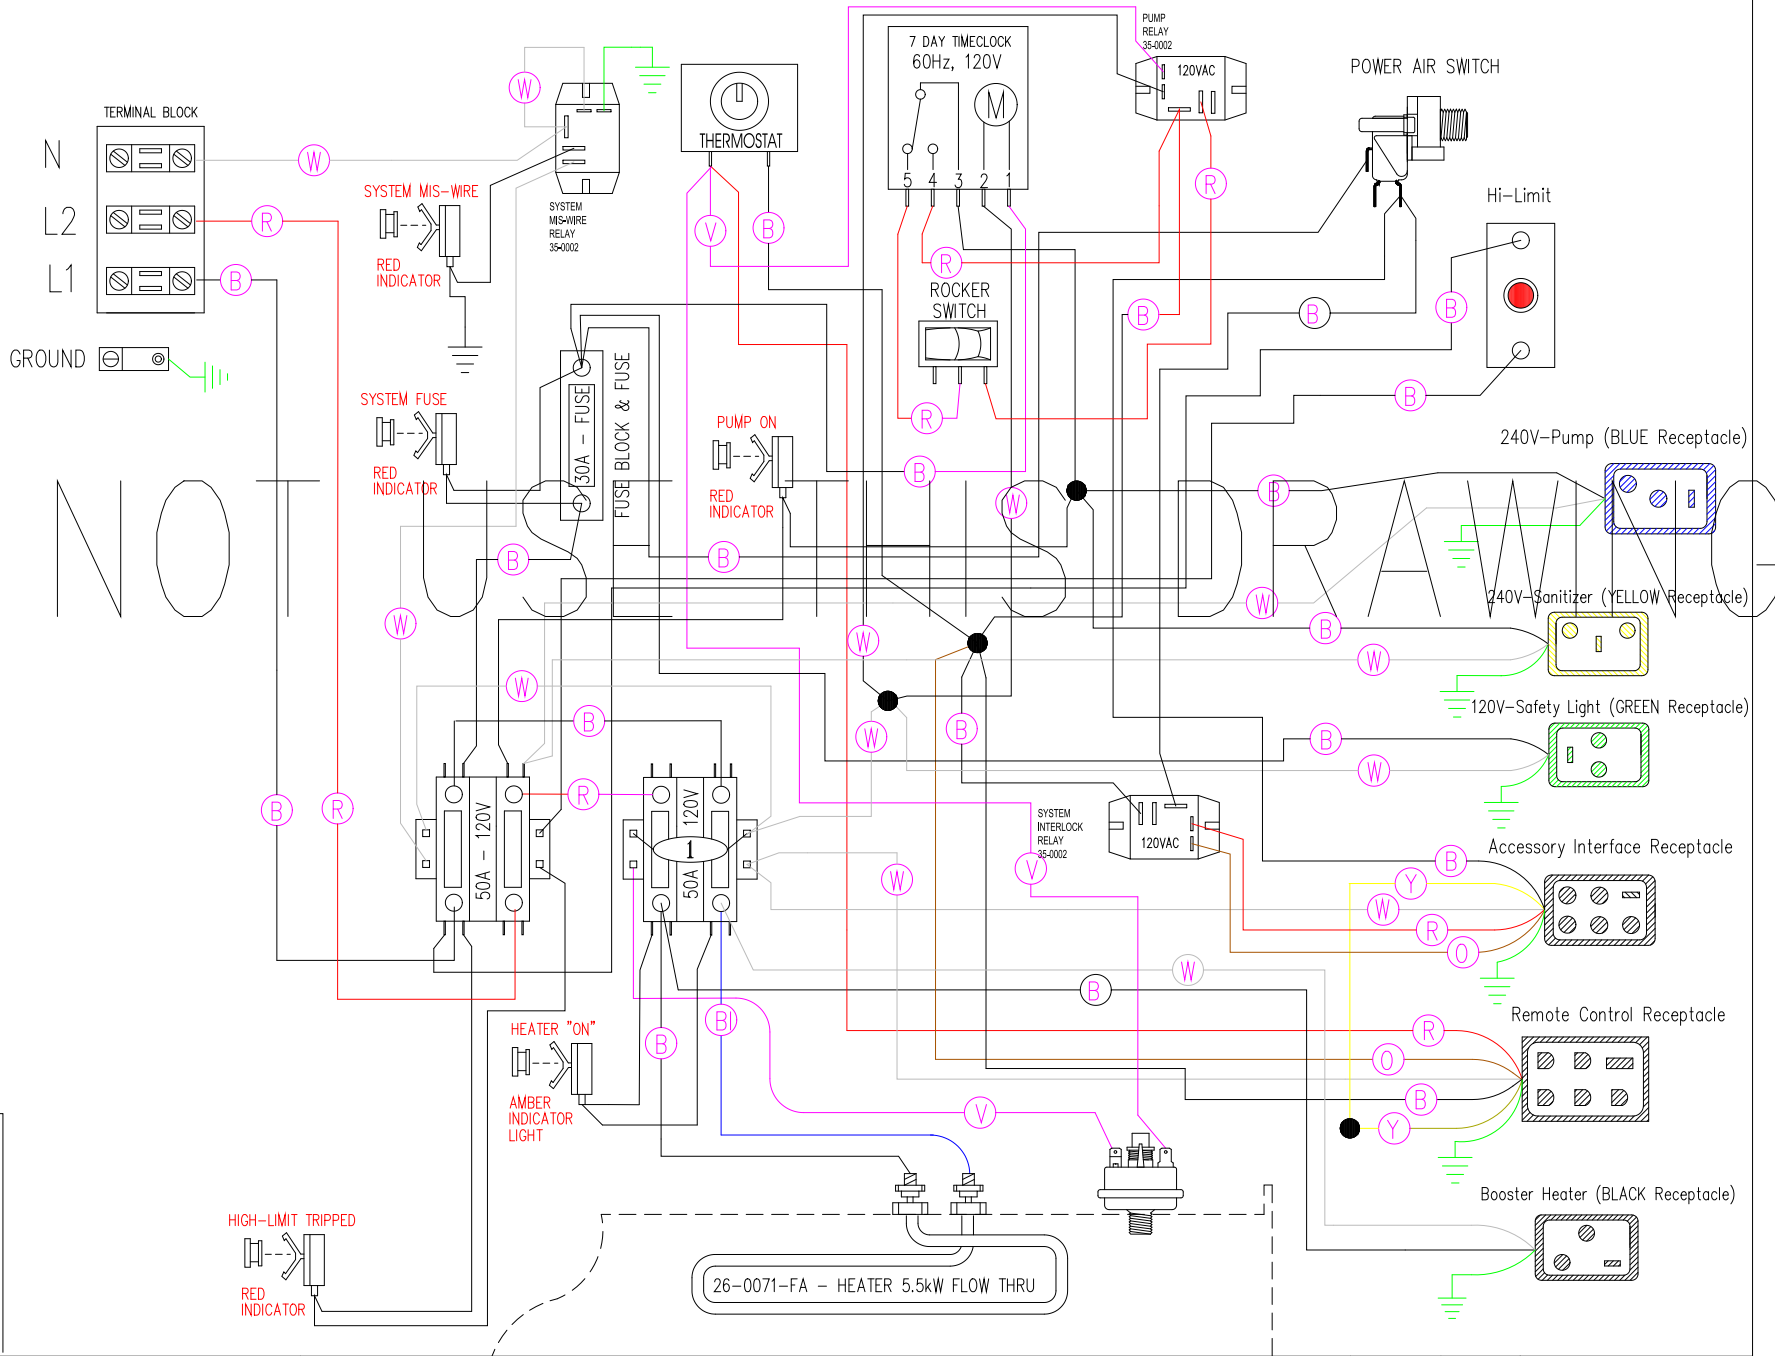

VDS CONFIGURATION

- HEATER "ON"
- PUMP "ON"
- CHECK SYSTEM FUSE
- HIGH-LIMIT TRIPPED
- SYSTEM MIS-WIRE

Manufacture Notes:

Dwg. No.	10000-HKQTY-J	Drawn	MBS	Rev	01	Wire Color Code	
Date	02.27.15					B - Black	G - Green
Diagram No.	2028					Br - Brown	Bl - Blue
						R - Red	V - Violet
						O - Orange	W - White
						Y - Yellow	Gr - Gray