



USE COPPER CONDUCTORS ONLY

DISCONNECT WHITE WIRE AT CONTACTOR AND MOVE TO TERMINAL BLOCK NEUTRAL

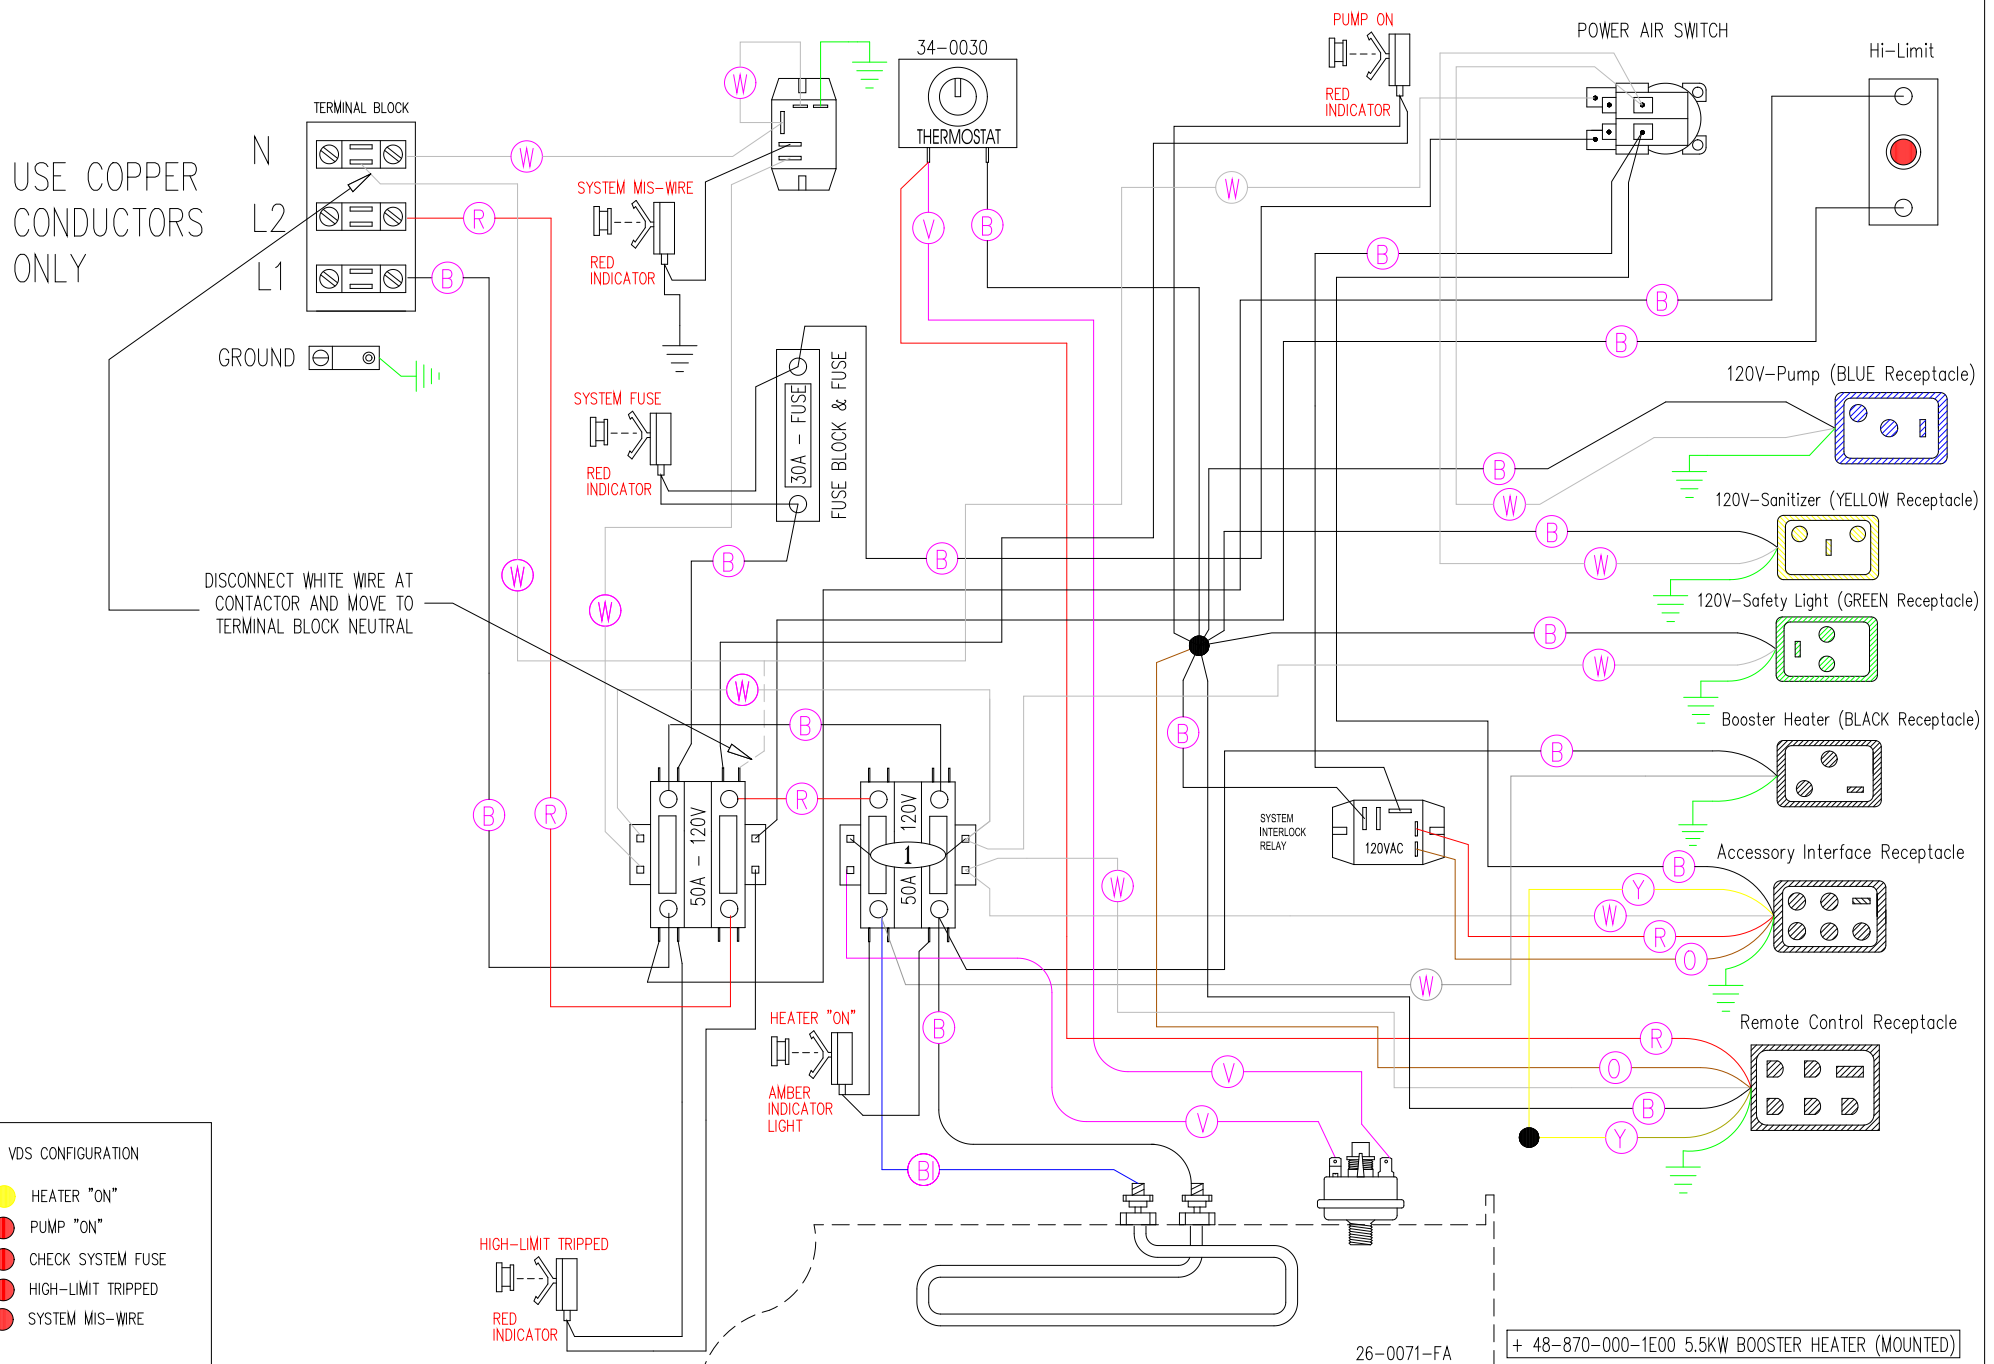

VDS CONFIGURATION

- HEATER "ON"
- PUMP "ON"
- CHECK SYSTEM FUSE
- HIGH-LIMIT TRIPPED
- SYSTEM MIS-WIRE



26-0071-FA

+ 48-870-000-1E00 5.5KW BOOSTER HEATER (MOUNTED)

Manufacture Notes:

DRAWING FOR SYSTEM CONVERSION ONLY

Dwg. No. 10000-HKQTY-J	Drawn MBS	Rev 02_Dev	Wire Color Code
Date 01.08.17	Diagram No. 2030		B - Black      G - Green Br - Brown    Bl - Blue R - Red        V - Violet O - Orange    W - White Y - Yellow     Gr - Gray