



USE COPPER CONDUCTORS ONLY

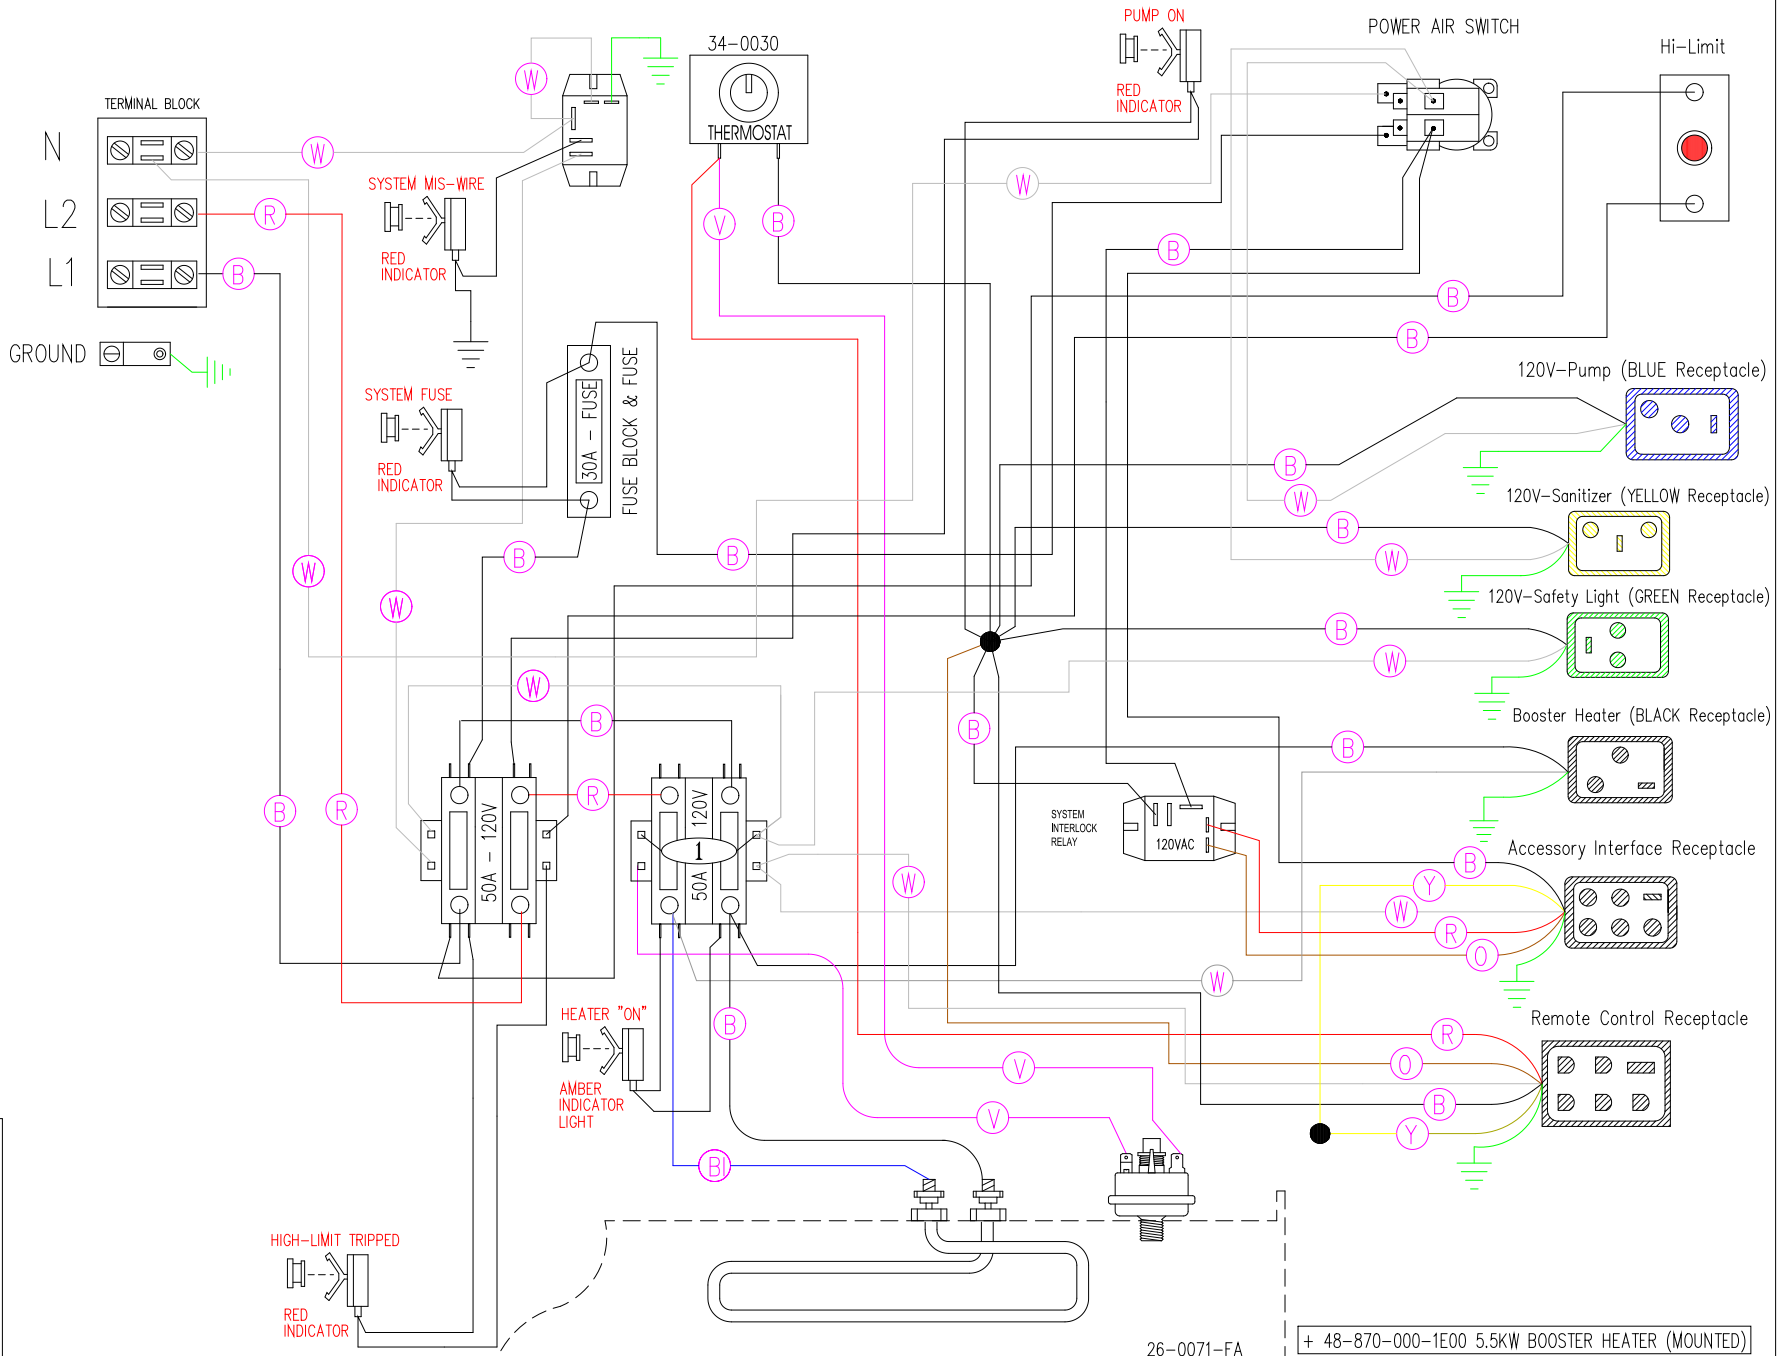

VDS CONFIGURATION

- HEATER "ON"
- PUMP "ON"
- CHECK SYSTEM FUSE
- HIGH-LIMIT TRIPPED
- SYSTEM MIS-WIRE



26-0071-FA

+ 48-870-000-1E00 5.5KW BOOSTER HEATER (MOUNTED)

Manufacture Notes:

Dwg. No. 10000-HKQTY-J	Drawn MBS	Rev 03	Wire Color Code B - Black Br - Brown R - Red O - Orange Y - Yellow G - Green Bl - Blue V - Violet W - White Gr - Gray
Date 01.08.17			
Diagram No. 2030			