TO CONVERT CIRCUIT 120 OR 240V MOVE WHITE WIRE ACCORDINGLY
120V COMPONENT = OPEN POSITION AT CONNECTION BLOCK #4
240V COMPONENT = OPEN POSITION AT CONNECTION BLOCK #2

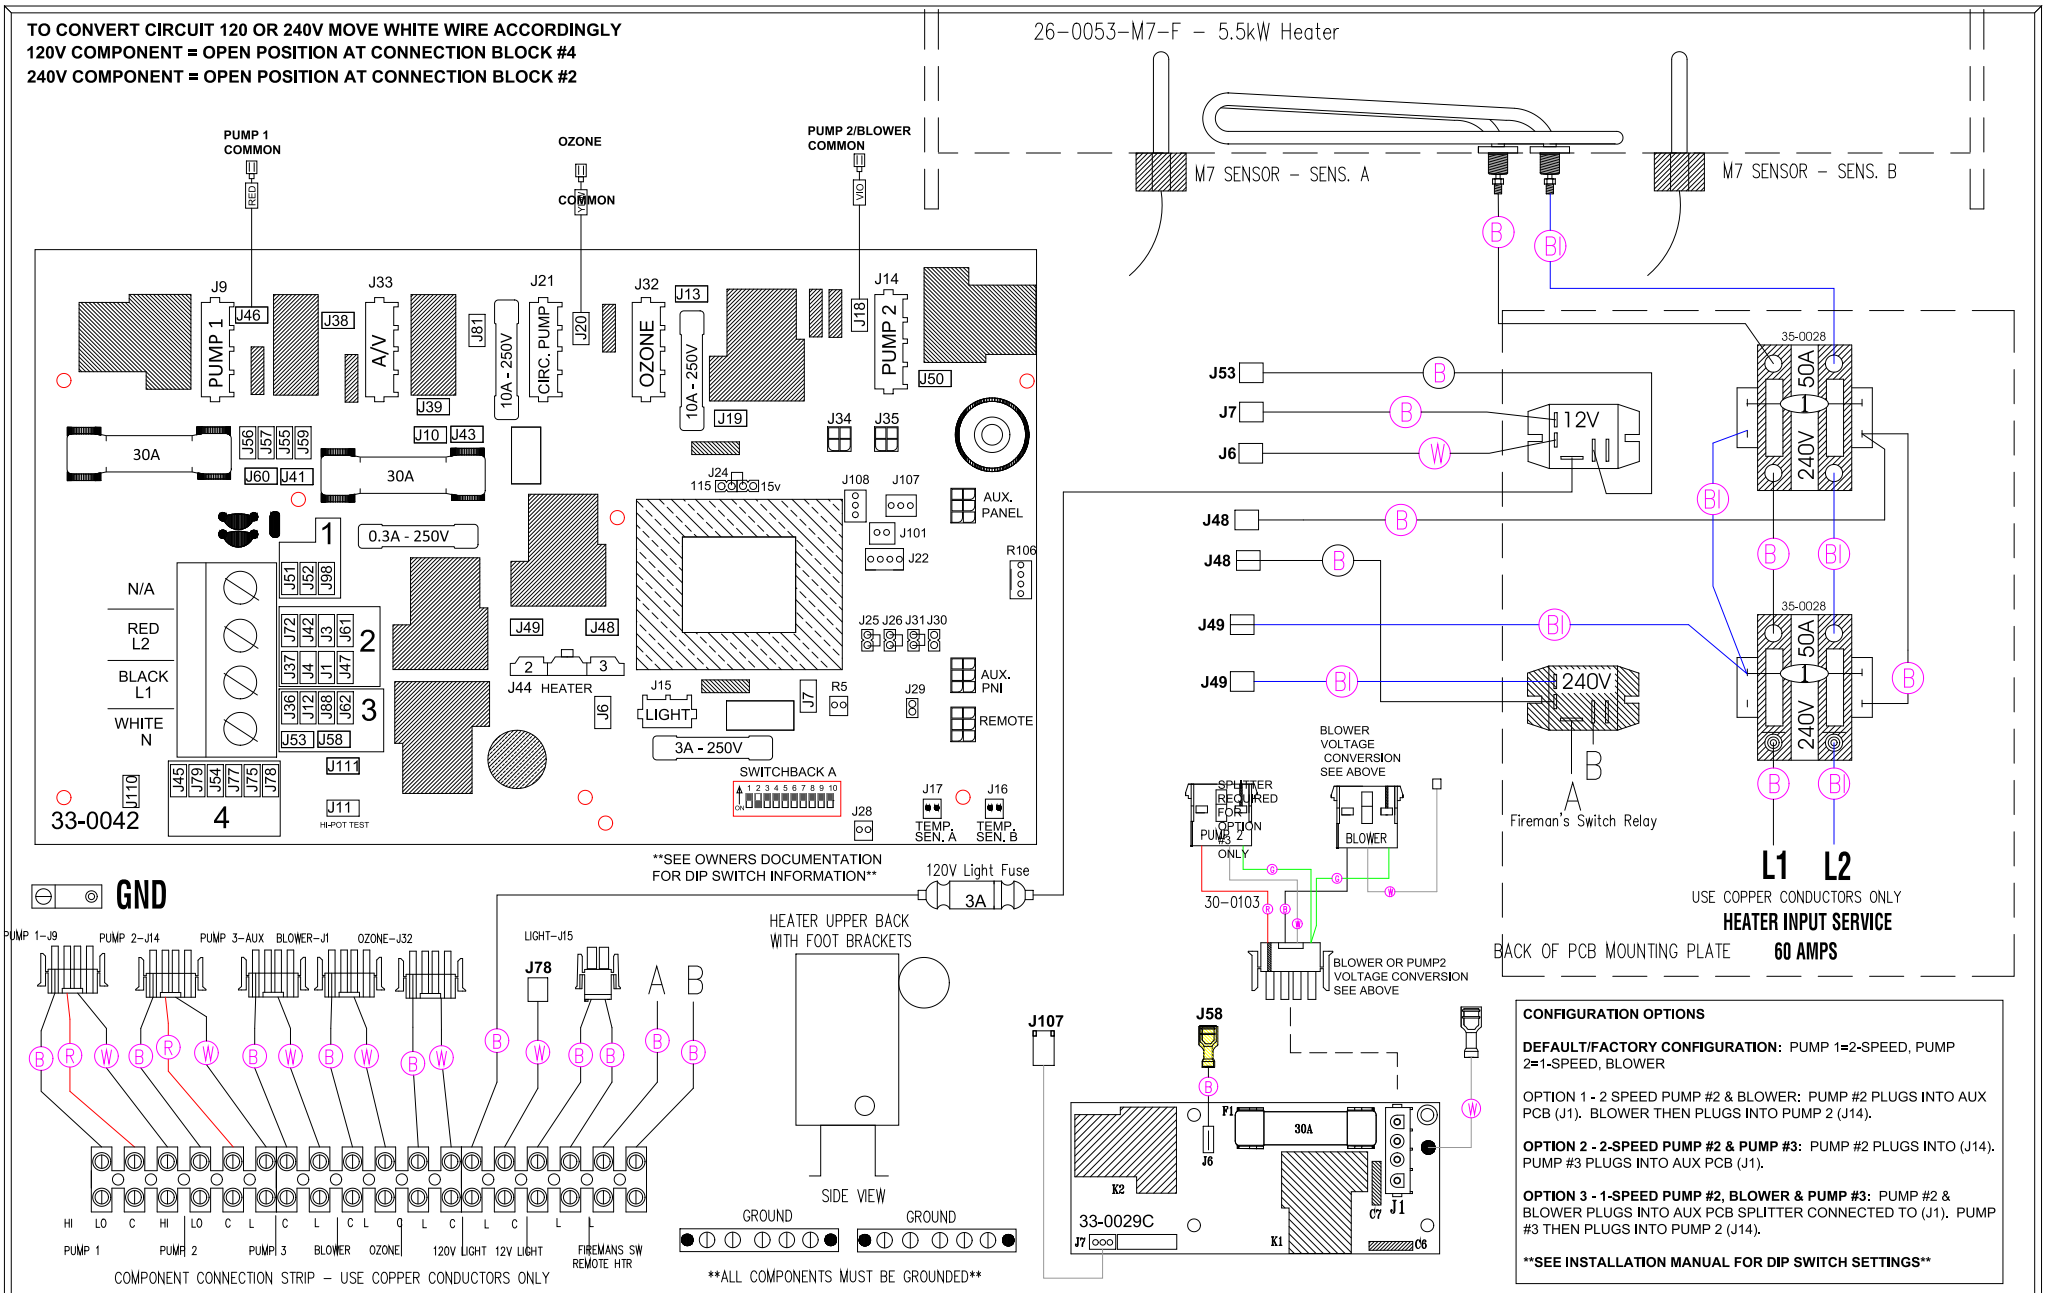

CONFIGURATION OPTIONS

DEFAULT/FACTORY CONFIGURATION: PUMP 1=2-SPEED, PUMP 2=1-SPEED, BLOWER

OPTION 1 - 2 SPEED PUMP #2 & BLOWER: PUMP #2 PLUGS INTO AUX PCB (J1). BLOWER THEN PLUGS INTO PUMP 2 (J14).

OPTION 2 - 2-SPEED PUMP #2 & PUMP #3: PUMP #2 PLUGS INTO (J14). PUMP #3 PLUGS INTO AUX PCB (J1).

OPTION 3 - 1-SPEED PUMP #2, BLOWER & PUMP #3: PUMP #2 & BLOWER PLUGS INTO AUX PCB SPLITTER CONNECTED TO (J1). PUMP #3 THEN PLUGS INTO PUMP 2 (J14).

SEE INSTALLATION MANUAL FOR DIP SWITCH SETTINGS

HYDRO-QUIP
CORONA, CA (951) 273-7575

Manufacture Notes:

Dwg. No.	Drawn	Rev
G822A0-KLPQY-J	MBS	01
	Date 05.12.15	
	Diagram No. 5186	

Wire Color Code

B - Black	G - Green
Br - Brown	Bl - Blue
R - Red	V - Violet
O - Orange	W - White
Y - Yellow	Gr - Gray