

HYDRO-QUIP
CORONA, CA (951) 273-7575

Approved By:

Dwg. No.
E203AH-KOQY

Drawn
MBS

Rev
01


Wire Color Code

Sheet Metal
65-0189

Date
02.23.10

B - Black G - Green
Br - Brown Bl - Blue
R - Red V - Violet
O - Orange W - White
Y - Yellow Gr - Gray

Diagram No.
6016A

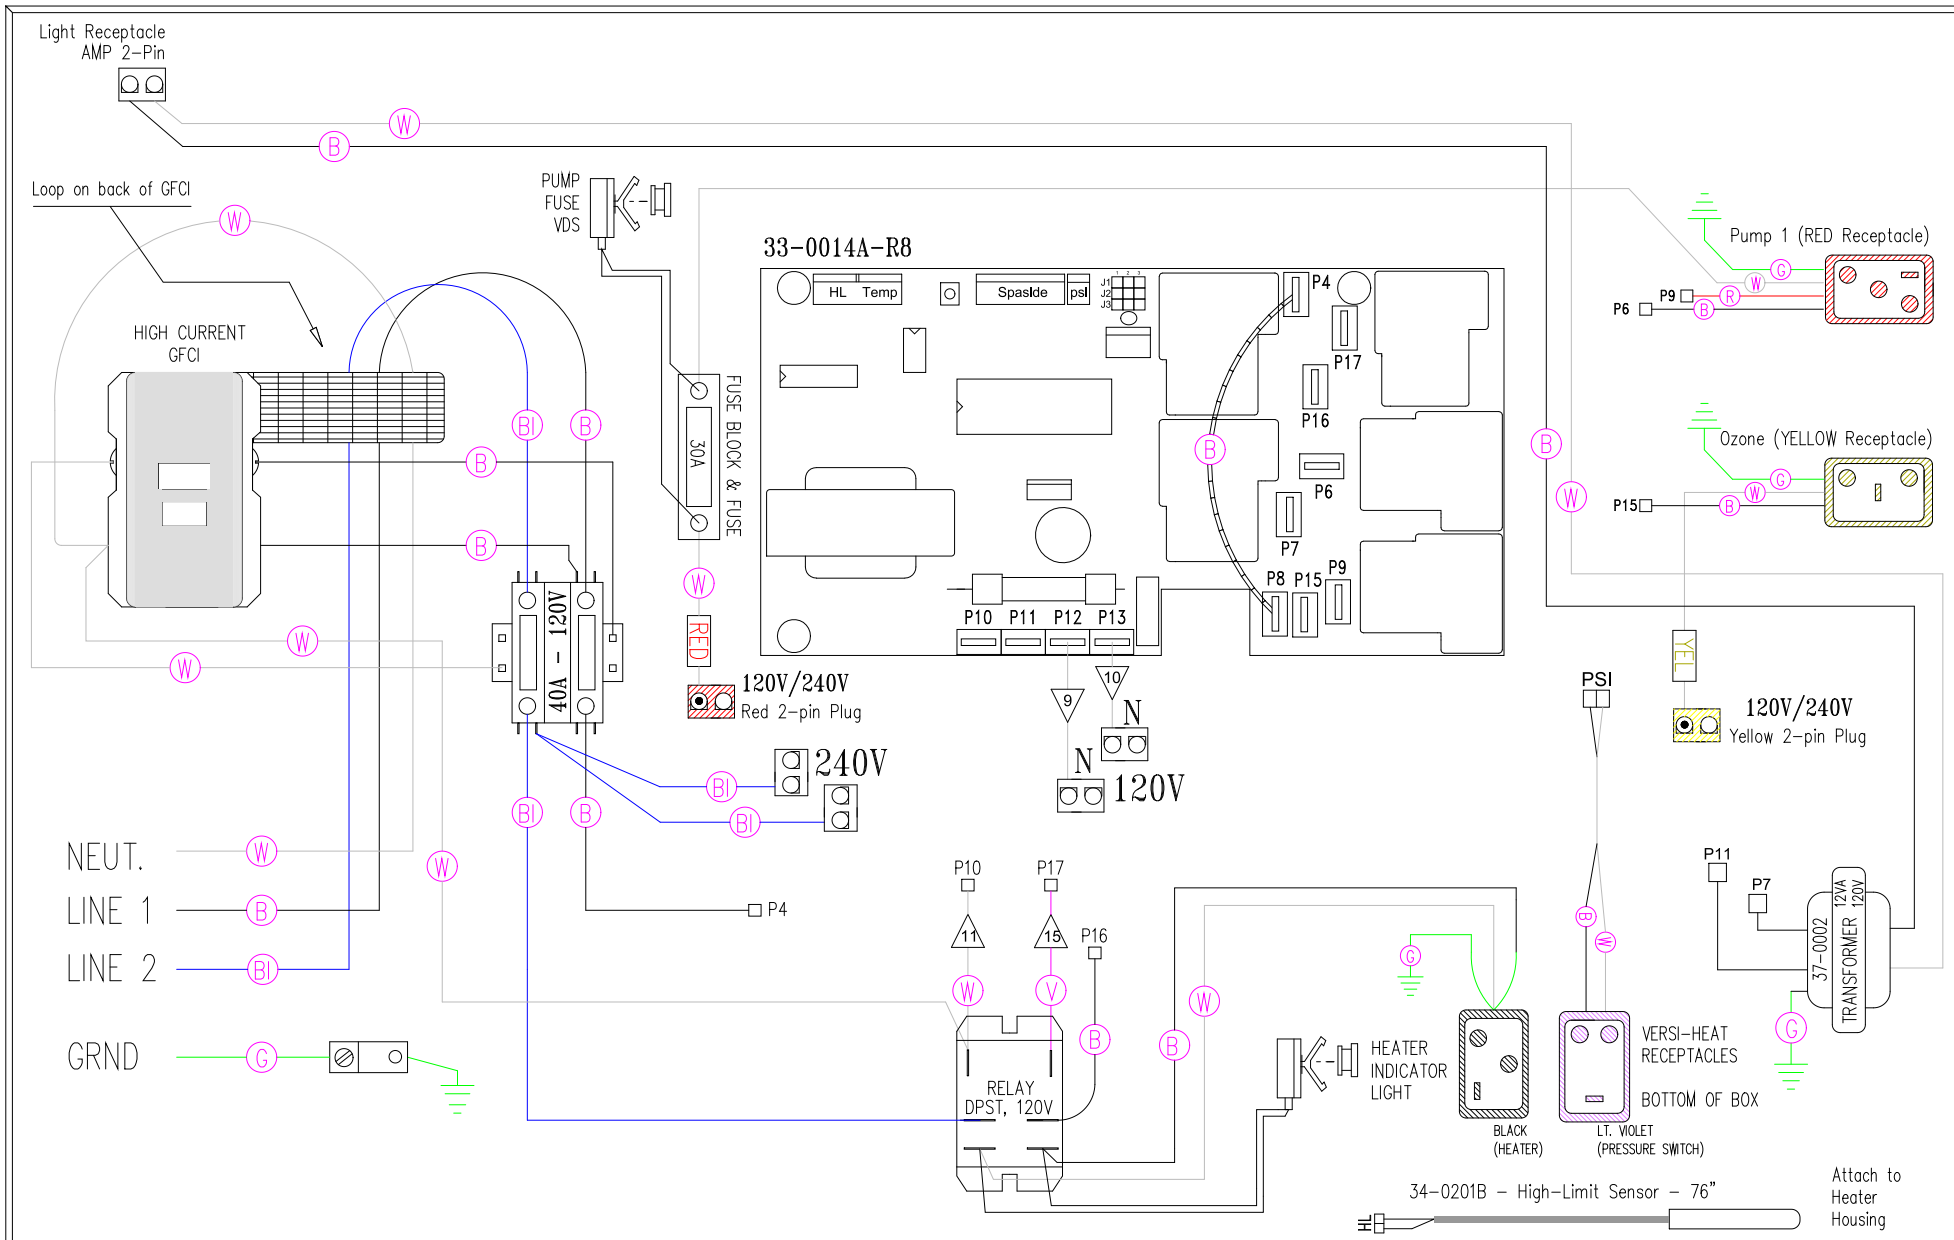

Light Receptacle
AMP 2-Pin

Loop on back of GFCI

HIGH CURRENT
GFCI

PUMP
FUSE
VDS

33-0014A-R8

FUSE BLOCK & FUSE
30A

120V/240V
Red 2-pin Plug

240V

120V

NEUT.

LINE 1

LINE 2

GRND

P10

P17

P16

RELAY
DPST, 120V

HEATER
INDICATOR
LIGHT

BLACK
(HEATER)

VERS-I-HEAT
RECEPTACLES

LT. VIOLET
(PRESSURE SWITCH)

Attach to
Heater
Housing

34-0201B - High-Limit Sensor - 76"

Pump 1 (RED Receptacle)

Ozone (YELLOW Receptacle)

120V/240V
Yellow 2-pin Plug

37-0002
12VA
120V
TRANSFORMER