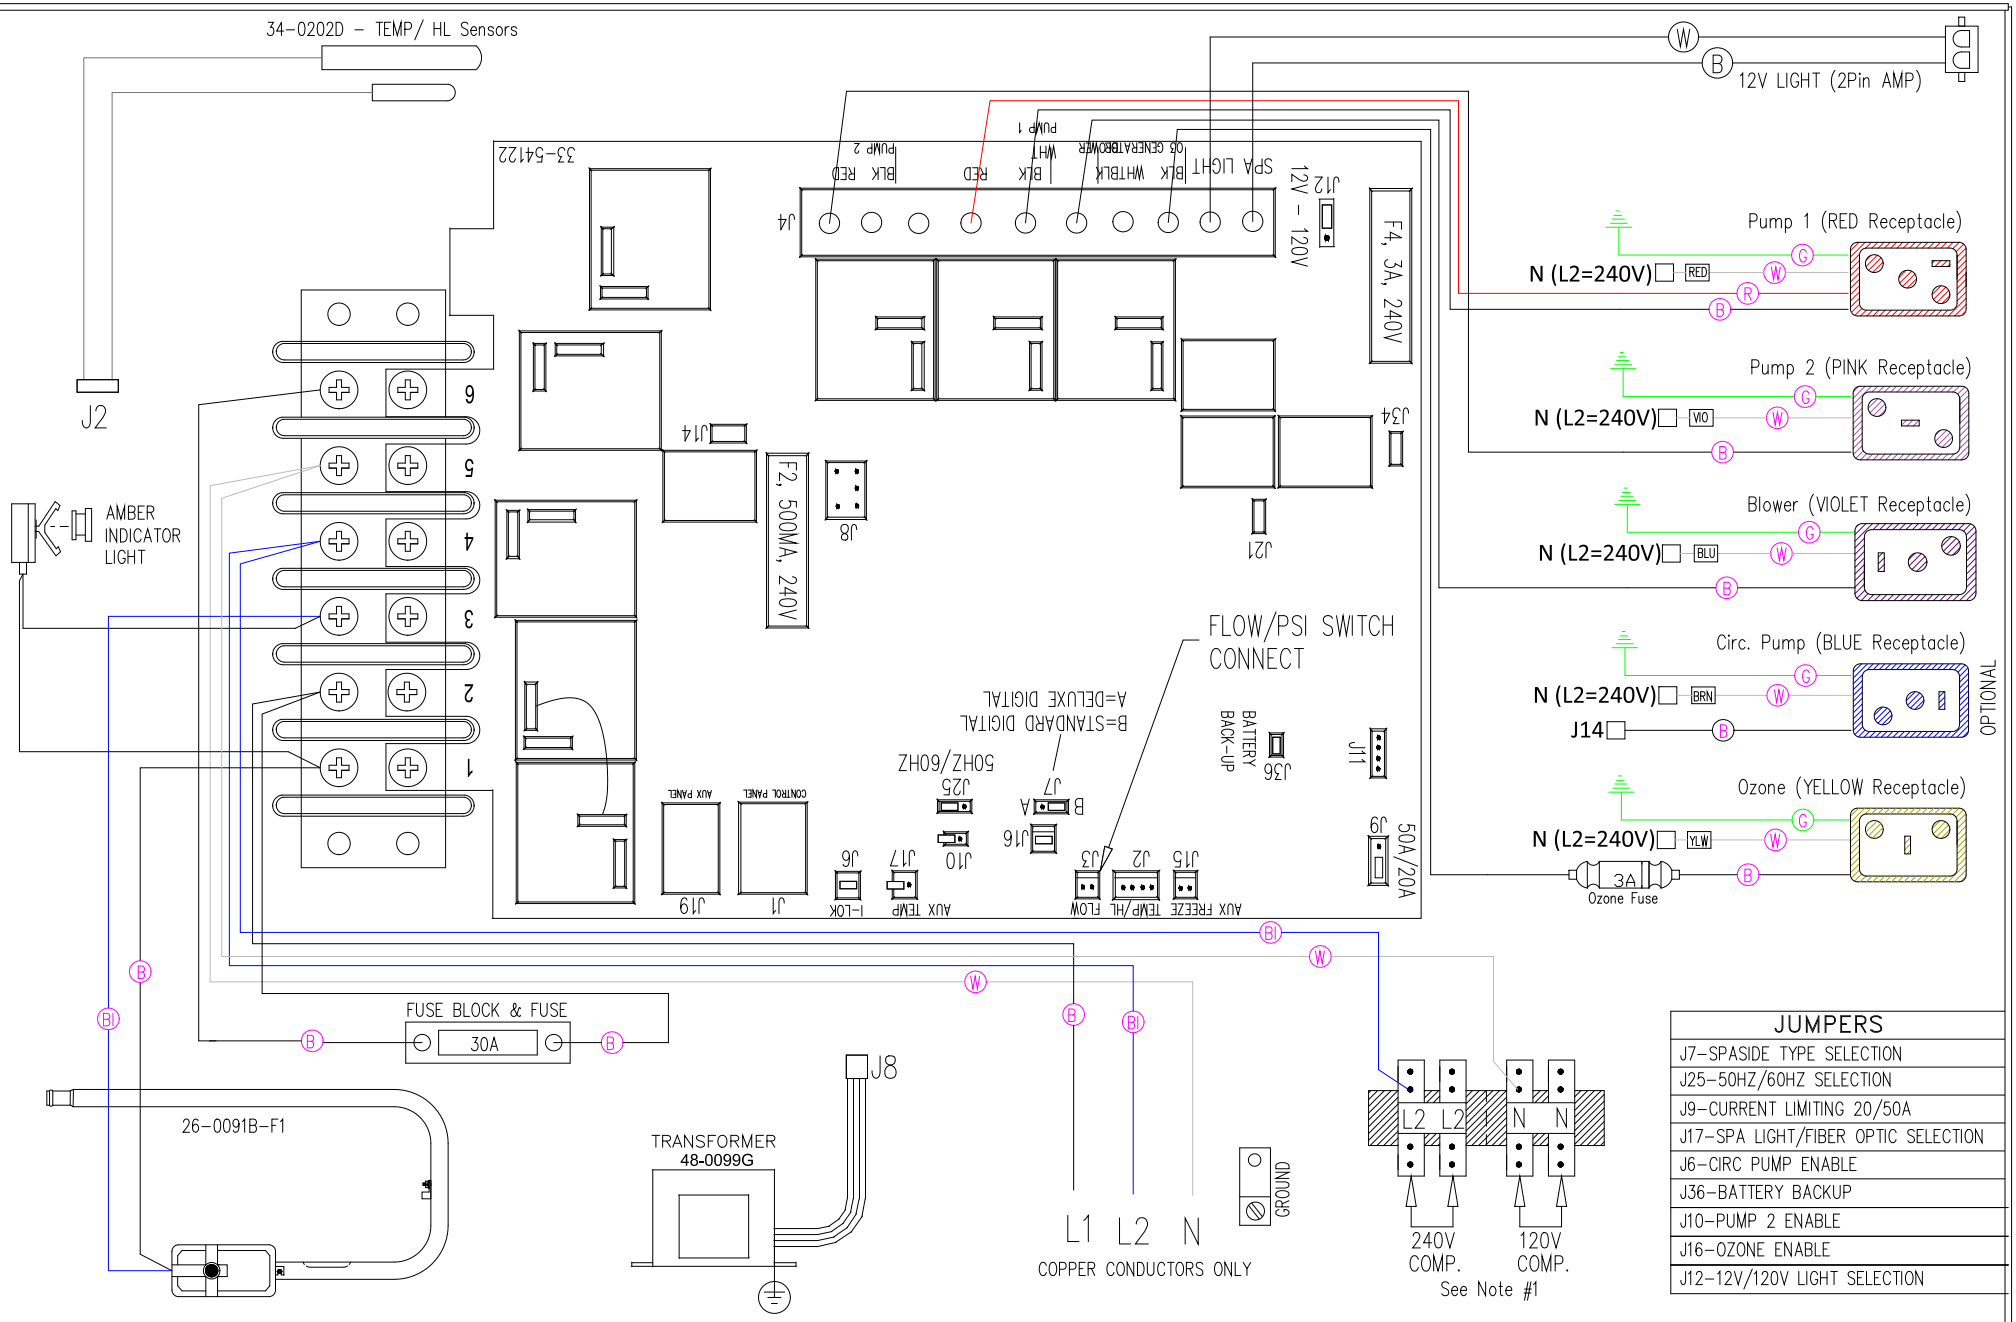

JUMPERS
J7–SPASIDE TYPE SELECTION
J25–50HZ/60HZ SELECTION
J9–CURRENT LIMITING 20/50A
J17–SPA LIGHT/FIBER OPTIC SELECTION
J6–CIRC PUMP ENABLE
J36–BATTERY BACKUP
J10–PUMP 2 ENABLE
J16–OZONE ENABLE
J12–12V/120V LIGHT SELECTION

HYDRO—QUIP
CORONA, CA (951) 273–7575

Manufacture Notes:

#1 Component Voltage Selection: Connect component WHITE (Common) wire to L2 for 240V or N for 120V operation.

#2 Line 2 and Neutral need to be jumpered for 120V operation.

Drawn	Rev
MBS	01
Date	
10.04.16	
Diagram No.	
9056	

Wire Color Code

B – Black	G – Green
Br – Brown	Bl – Blue
R – Red	V – Violet
O – Orange	W – White
Y – Yellow	Gr – Gray