


TO CONVERT CIRCUIT 120V OR 240V MOVE WHITE WIRE ACCORDINGLY  
 120V COMPONENT = OPEN POSITION AT CONNECTION BLOCK "N"  
 240V COMPONENT = OPEN POSITION AT CONNECTION BLOCK "L2"

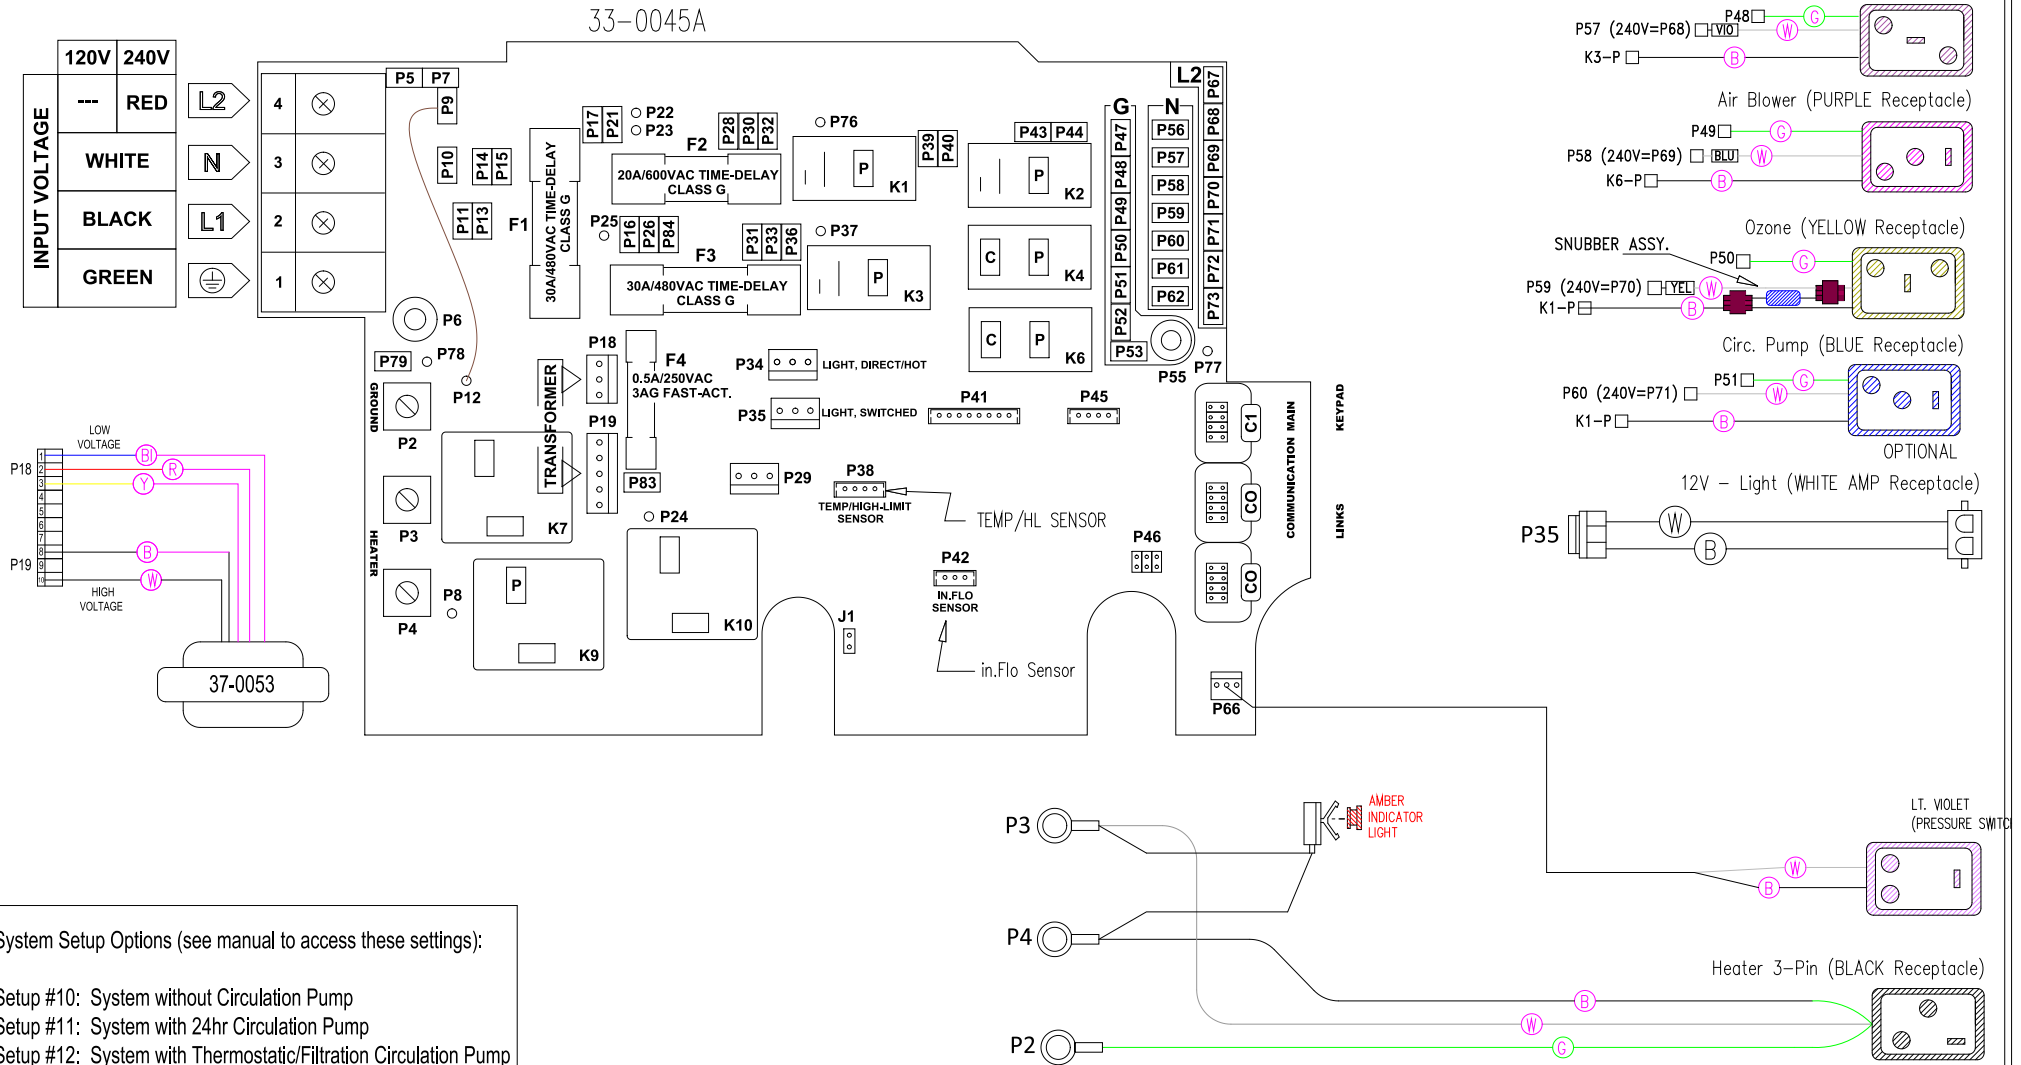

System Setup Options (see manual to access these settings):

- Setup #10: System without Circulation Pump
- Setup #11: System with 24hr Circulation Pump
- Setup #12: System with Thermostatic/Filtration Circulation Pump

HYDRO-QUIP  
 CORONA, CA (951) 273-7575

Manufacture Notes:

A disconnect means must be installed within sight from the equipment and at least five feet (1.52m) from the inside walls of pool, spa, or hot tub.

Drawn	Rev	Wire Color Code
MBS	01	
Date	11.14.17	
Diagram No.	9122	
B - Black	G - Green	
Br - Brown	Bl - Blue	
R - Red	V - Violet	
O - Orange	W - White	
Y - Yellow	Gr - Gray	